


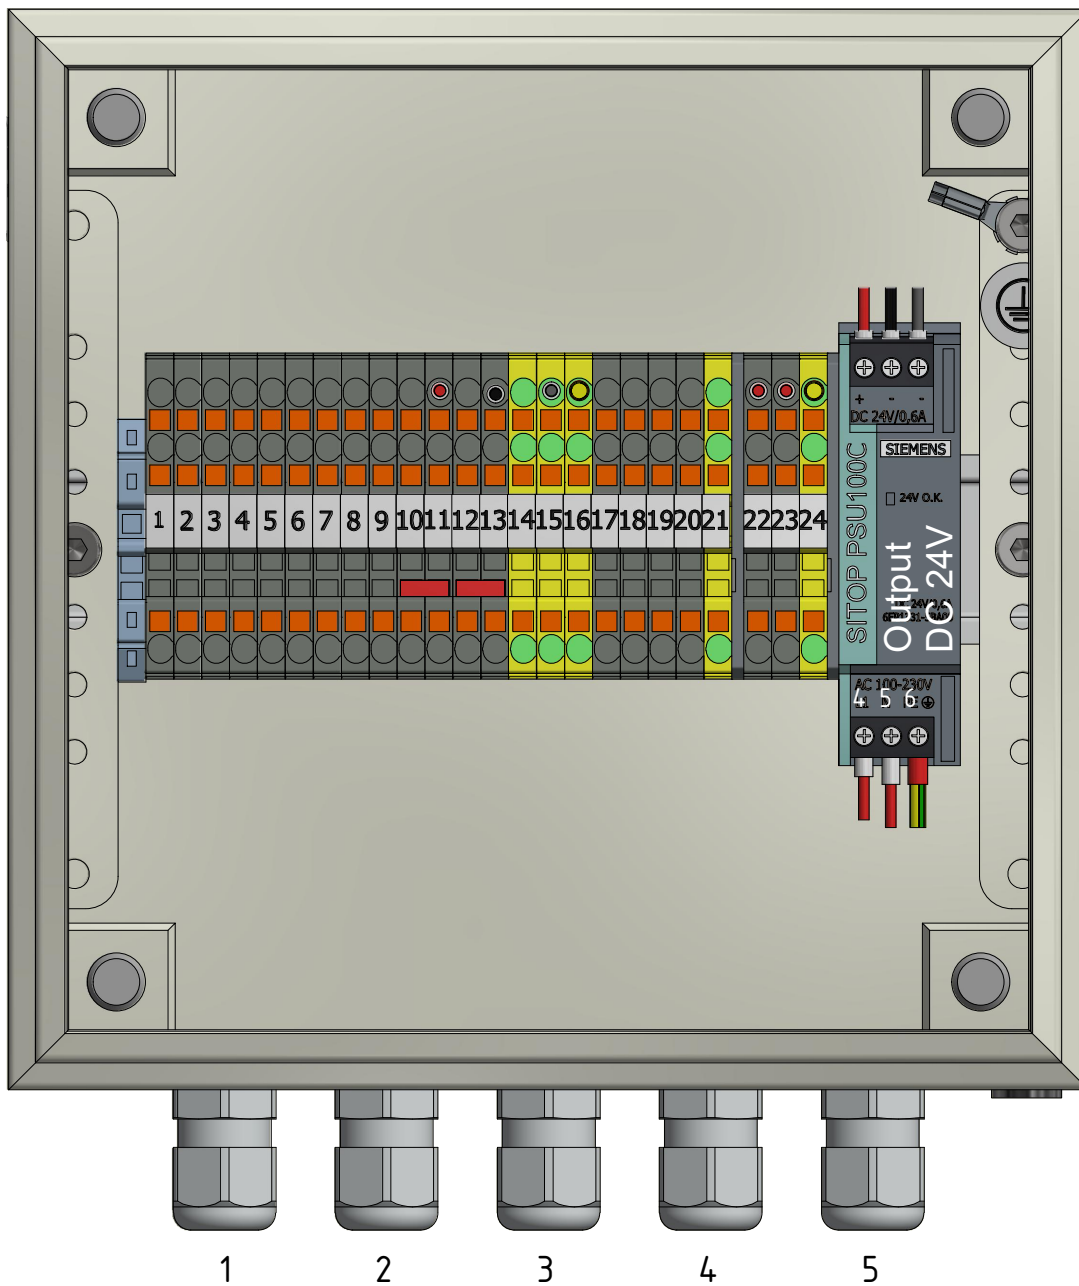

## Aderfarb

A rosa  
B weiß  
C grau  
D gelb  
E violett  
F braun  
G grün  
H rot-blau  
J rot  
K grau-rosa  
L blau  
M schwarz  
grau Schirm


## Strömung

Kl. Strömung  
Term. Flow Co

1 — br  
2 — we  
4 — sc  
3 — bl  
So


- 1) Eingang Pyrometer  
Input Pyrometer
- 2) Ausgang Pyrometer  
Output Pyrometer
- 3) Eingang Strömungswächter  
Input Flow Controller

- 4) Ausgang Strömungswächter  
Output Flow Controller
- 5) Spannungsversorgung  
Power Supply

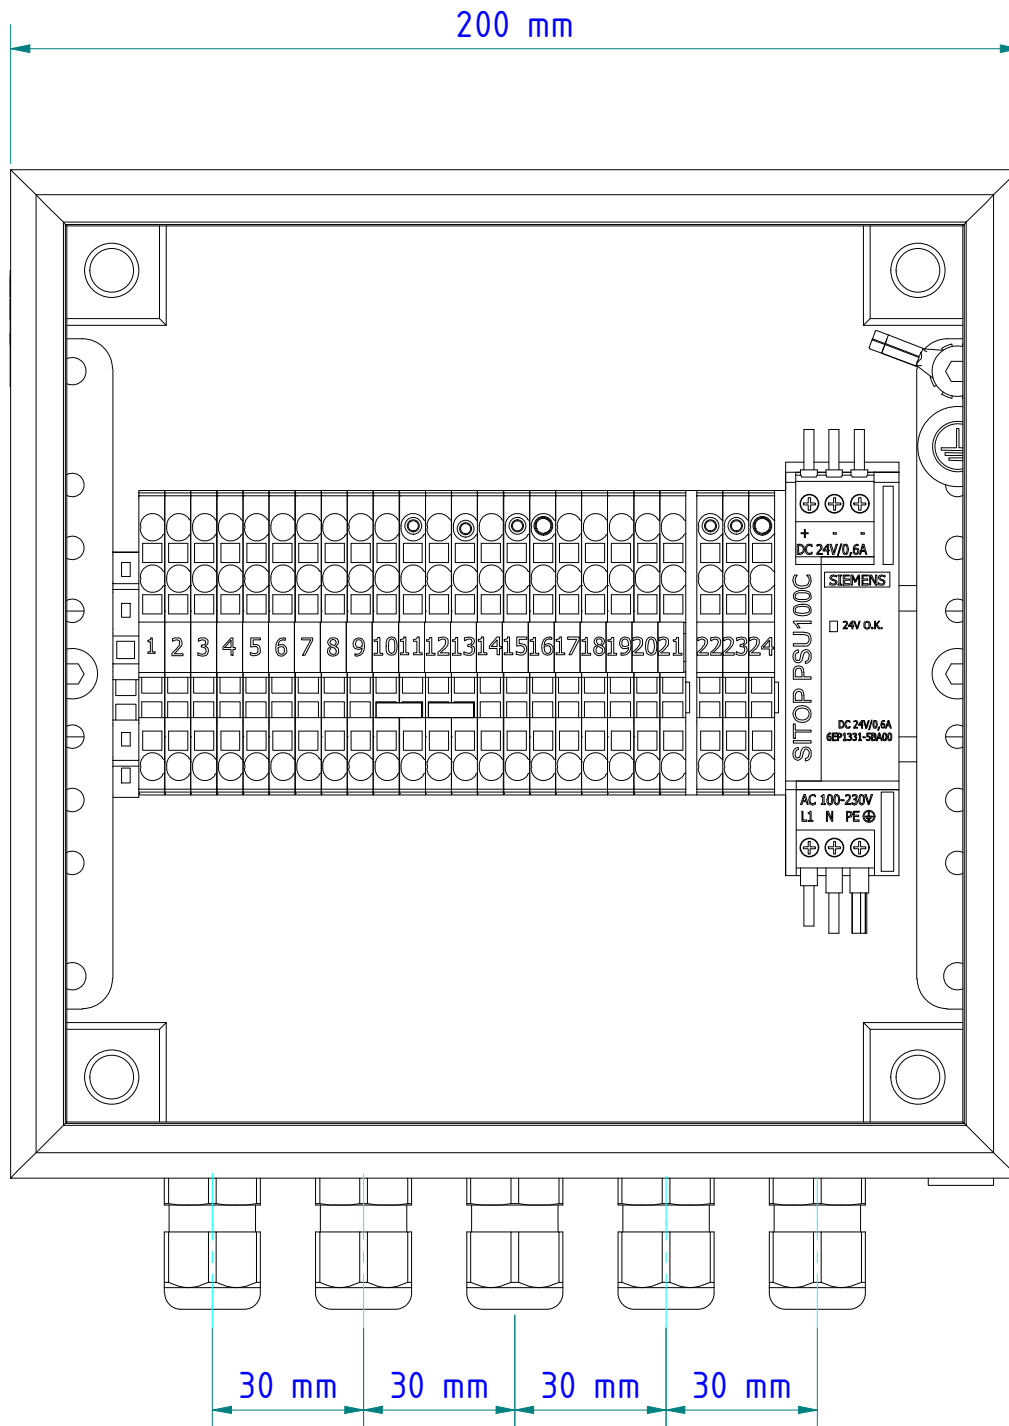



- Headquarters
- Sales and Service Center
- Sales abroad



Keller HCW GmbH  
Infrared Temperature Solutions (ITS)  
Carl-Keller-Straße 2-10  
49479 Ibbenbüren-Laggenbeck  
Germany

[www.keller.de/its](http://www.keller.de/its)  
Tel. +49 (0) 5451 850  
Fax +49 (0) 5451 85412  
[its@keller.de](mailto:its@keller.de)

## Distributor



INOR Transmitter Oy  
Unikkotie 13  
FI-01300 Vantaa  
Puhelin +358 10 4217900  
Faksi +358 10 4217901  
[myynti@inor.fi](mailto:myynti@inor.fi)